


# Population Results for C8 and C8 Sulfonate Plasma Concentrations Stratified by Participant's Qualifying Water District

All Age and Gender Groups

## Case Summaries

Qualifying Water District		C8 (Final Test Value; Numeric)	C8S (Final Test Value; Numeric)
Mason County, WV	Mean	14.5561	22.9114
	Median	12.0000	19.7000
	Minimum	.60	.50
	Maximum	525.20	274.90
	Std. Deviation	11.58330	14.59610
	Std. Error of Mean	.10490	.13251
City of Belpre, OH	Mean	43.3626	23.2543
	Median	27.1000	20.4000
	Minimum	.50	.70
	Maximum	7932.00	245.80
	Std. Deviation	107.52400	14.99425
	Std. Error of Mean	1.16957	.16340
Little Hocking Water Association, OH	Mean	226.7114	23.4114
	Median	132.4500	20.3000
	Minimum	.60	.50
	Maximum	22412.00	759.20
	Std. Deviation	349.68251	15.68320
	Std. Error of Mean	3.11943	.14016
Lubeck Public Service District, WV	Mean	94.3865	25.3850
	Median	45.9000	22.1000
	Minimum	.50	.50
	Maximum	17556.60	291.50
	Std. Deviation	325.29059	15.87031
	Std. Error of Mean	2.54172	.12433
Tuppers Plains, OH	Mean	39.5996	21.9942
	Median	28.1000	18.9000
	Minimum	.50	.60
	Maximum	8162.80	585.20
	Std. Deviation	86.44557	15.92322
	Std. Error of Mean	.74184	.13679
Village of Pomeroy, OH	Mean	14.0692	20.6339
	Median	11.5500	17.7000
	Minimum	.60	.60
	Maximum	287.00	207.40
	Std. Deviation	13.21007	13.92657
	Std. Error of Mean	.22209	.23437
Total	Mean	82.8443	23.3475
	Median	28.2000	20.2000
	Minimum	.50	.50
	Maximum	22412.00	759.20
	Std. Deviation	240.09476	15.46953
	Std. Error of Mean	.92960	.06001

Median C8 Values for Qualifying Water Districts

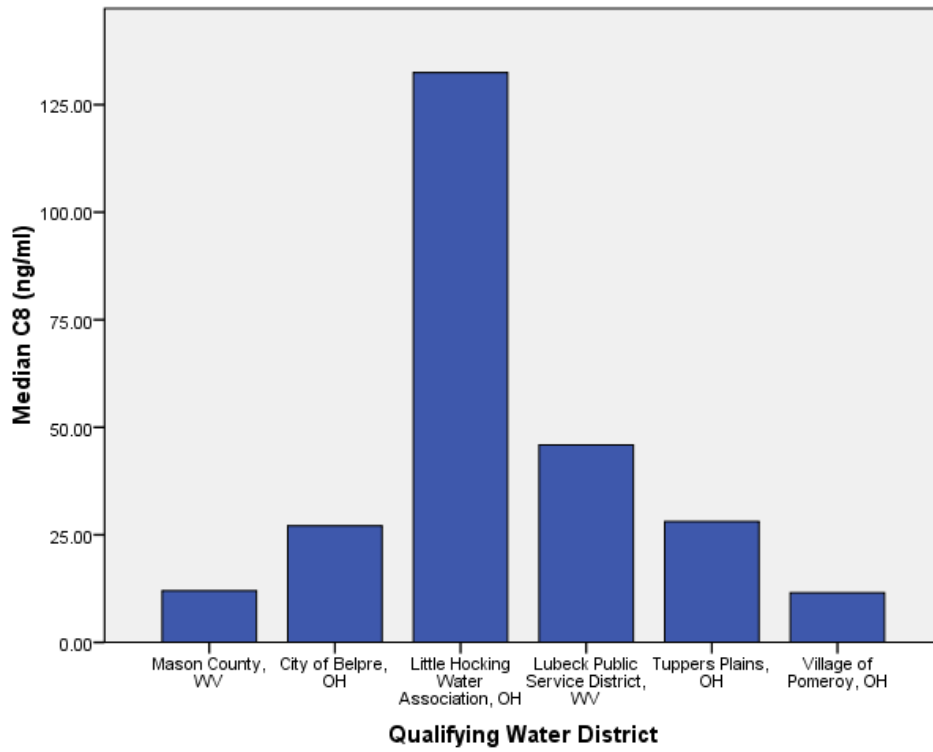

Median C8 Sulfonate Values for Qualifying Water Districts

